# Single <mark>Packs</mark>



## Single Pack FF7.5GK 115V 60Hz RSIR

Single pack code number: 195B4108

Position	Title	Code	Amount
1	Compressor FF7.5GK	103G5780	1
2	Starting relay (overload protector MRP38JL-6)	117U4085	1
3	Cord relief	117U0349	1
4	Cover	117U1021	1
5	Bolt joint for one compressor   M6   ø16mm	118-1917	1

Secop GmbH • Lise-Meitner-Straße 29 • 24941 Flensburg, Germany • Tel: +49 461 4941 0 • www.secop.com

Secop accepts no responsibility for possible errors in catalogs, brochures, and other printed material. Secop reserves the right to alter its products without notice. This also applies to products already on order provided that such alterations can be made without subsequential changes being necessary to specifications already agreed. All trademarks in this material are the property of the respective companies. Secop and the Secop logotype are trademarks of Secop GmbH. All rights reserved.

#### FF7.5GK **Universal Compressor** R134a 115V 60Hz General


Ocheral	
Code number	103G5780
Approvals	UL984
Compressors on pallet	80

#### Application

Application	LBP/HBP			
Frequency	Hz	50	60	
Evaporating temperature	°F	_	-22 to 50	
Voltage range	V	-	103 - 127	
Max. condensing temperature continuous (short)	°F	_	140 (158)	
Max. winding temperature continuous (short)	°F	_	257 (275)	

#### **Cooling requirements**

Frequency	Hz	50			60			
Application		LBP	MBP	HBP	LBP	MBP	HBP	
90°F		-	-	-	F <sub>1</sub>	F <sub>1</sub>	F <sub>1</sub>	
100°F		-	-	-	F <sub>1</sub>	F <sub>1</sub>	F <sub>1</sub>	
110°F		-	-	-	F <sub>1</sub>	F <sub>1</sub>	F <sub>1</sub>	
Remarks on application:								





- = Static cooling normally sufficient
- 0 = Oil cooling

S

- $F_1 = Fan \text{ cooling } 1.5 \text{ m/s}$ (compressor compartment temperature equal to ambient temperature)
- F<sub>2</sub> = Fan cooling 3.0 m/s necessary
- SG = Suction gas cooling normally sufficent \_
  - = not applicable in this area

### Motor


Motor type		RSIR			
LRA (rated after 4 sec. UL984), HST   LST	А	-	25.0		
Cut in Current, HST   LST	А	-	25.0		
Resistance, main   start winding (77°F)	Ω	2.2	8.3		

#### Design

Displacement	cu.in	0.42
Oil quantity (type)	fl.oz.	13.5 (polyolester)
Maximum refrigerant charge	OZ.	32.0
Free gas volume in compressor	fl.oz.	47.3
Weight without electrical equipment	lbs.	23.3


#### Dimensions


Height	inch	A 7.72
		B 7.52
		B1 –
		B2 –
Suction connector	location, I.D. in.   angle	C 0.320-0.327   30°
	material   comment	Cu-plated steel   AI cap
Process connector	location, I.D. in.   angle	D 0.252-0.259   30°
	material   comment	Cu-plated steel   AI cap
Discharge connector	location, I.D. in.   angle	E 0.252-0.259   25°
	material   comment	Cu-plated steel   Al cap
Oil cooler connector	location, I.D. in.   angle	F –
	material   comment	-
Remarks:		

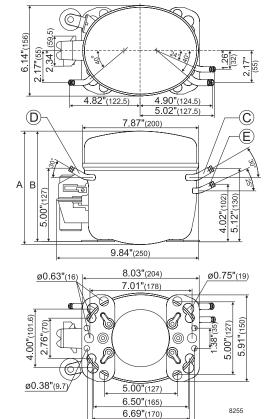

7.32"(186)

ASHRAE LBP			115V,	60Hz, fa	an cooli	ing F <sub>1</sub>											
Evap. temp. in °F	-49	-40	-30	-20	-13	-10	0	10	14	20	30	32	40	45	50	59	68
Capacity in BTU/h				328	452	516	777	1111	1258	1518	2000	2100	2556	2863	3189		
Power cons. in W				115	138	148	182	216	230	250	286	294	322	340	359		
Current cons. in A				1.90	2.02	2.07	2.28	2.51	2.61	2.76	3.03	3.10	3.32	3.47	3.62		
EER in BTU/Wh				2.86	3.28	3.49	4.27	5.15	5.46	6.06	7.00	7.16	7.94	8.41	8.88		
ASHRAE HBP		115V,	60Hz, fa	an cooli	ng F <sub>1</sub>												
Evap. temp. in °F	-49	-40	-30	-20	-13	-10	0	10	14	20	30	32	40	45	50	59	68
Capacity in BTU/h				291	401	458	689	984	1128	1344	1769	1872	2259	2529	2816		
Power cons. in W				115	138	148	182	216	229	250	286	292	322	340	359		
Current cons. in A				1.90	2.02	2.07	2.28	2.51	2.61	2.76	3.03	3.09	3.32	3.47	3.62		
EER in BTU/Wh				2.54	2.91	3.09	3.79	4.56	4.91	5.37	6.19	6.41	7.02	7.43	7.84		
EN 12900 Household	(CECO	MAF)	115V,	60Hz, fa	an cooli	ng F <sub>1</sub>											
Evap. temp. in °F	-49	-40	-30	-20	-13	-10	0	10	14	20	30	32	40	45	50	59	68
Capacity in W				79	108	123	186	265	299	362	477	498	608	681	757		
Power cons. in W				115	138	148	182	216	230	250	286	294	322	340	359		
Current cons. in A				1.90	2.02	2.07	2.28	2.51	2.61	2.76	3.03	3.10	3.32	3.47	3.62		
COP in W/W				0.69	0.78	0.83	1.02	1.23	1.30	1.45	1.67	1.69	1.89	2.00	2.11		

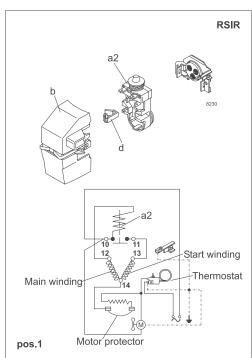

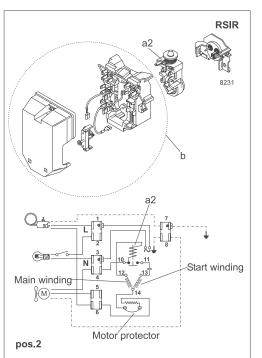


Ø: 5/8 in.

Accessories for	FF7.5GK Figure Code number Test conditions		F7.5GK Figure Code number Test conditions ASHRA LBP				ASHRAE LBP	ASHRAE HBP	EN 12900/ CECOMAF
Starting relay	1/4 in. spade connect.	- 2	117U4085	Condensing temp.	130°F	130°F	131°F		
Protector 3/4 in.	Texas Instruments	a2	MRP38JL-6	Ambient temp.	90°F	95°F	90°F		
Cover (standard)		b	117U1021	Suction gas temp.	90°F	95°F	90°F		
Cord relief		d	117U0349	Liquid temperature	90°F	115°F	131°F		
		(pos.1)		<u> </u>					
Cover (alternative)			44714004	Mounting accessories Code numl			number		
with terminal board			117U1024	Bolt joint for one comp.	o. Ø: 5/8 in. 11		8-1917		
				Bolt joint in quantities	Ø: 5/8 in.	118-	1918		

Secop accepts no responsibility for possible errors in catalogs, brochures, and other printed material. Secop reserves the right to alter its products without notice. This also applies to products already on order provided that such alterations can be made without subsequential changes being necessary to specifications already agreed. All trademarks in this material are the property of the respective companies. Secop and the Secop logotype are trademarks of Secop GmbH. All rights reserved. **www.secop.com** 


Snap-on in quantities

118-1919



### **FF Compressors**




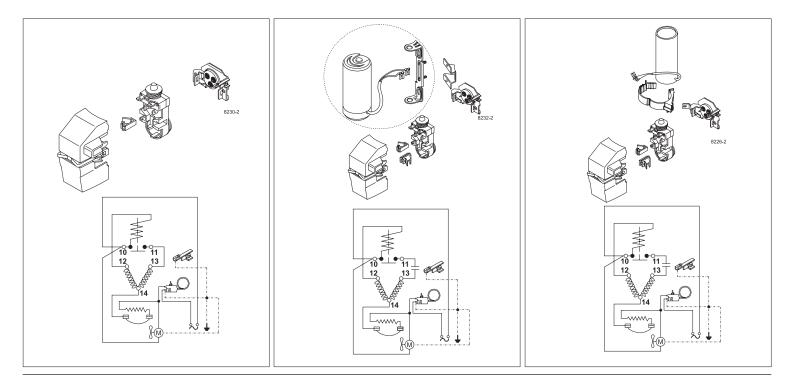

February 2011

DES.I.200.B1.02 / 520N0365

1/2

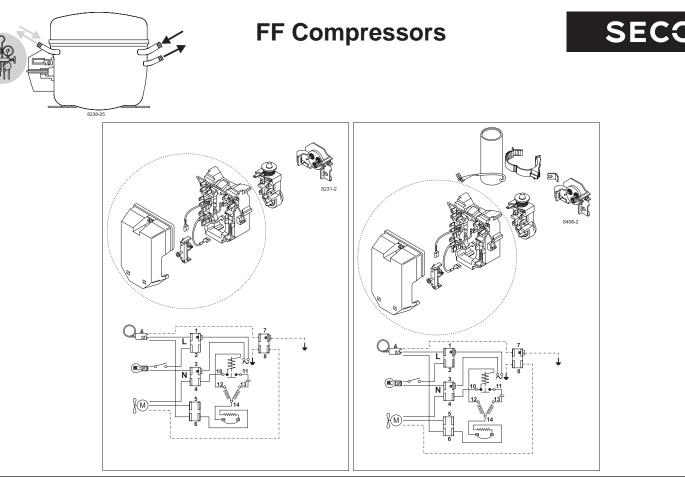

Secop accepts no responsibility for possible errors in catalogs, brochures, and other printed material. Secop reserves the right to alter its products without notice. This also applies to products already on order provided that such alterations can be made without subsequential changes being necessary to specifications already agreed. All trademarks in this material are the property of the respective companies. Secop and the Secop logotype are trademarks of Secop GmbH. All rights reserved. www.secop.com

2/2

DES.I.200.B1.02 / 520N0365

February 2011